


# NOTES THIS DETAIL:


1. ALL LETTERING & ARTWORK SHALL BE FLUSH WITH FRAME RIM/LIP MOLDED INTO THE TOP OF THE COVER.
2. FRAME SHALL BE GRAY IRON CONFORMING TO A.S.T.M. A48-90, GRADE 30. COVER SHALL BE DUCTILE IRON CONFORMING TO A.S.T.M. A536-84, CLASS 80-50-06.
3. FIT TOLERANCES SHALL BE  $< 1/8" \pm$ .
4. WELDED FRAME & COVERS ARE NOT ACCEPTABLE.
5. ALL FRAME & COVERS SET ON MANHOLES IN DEPRESSION AREAS SUBJECTED TO STORM WATER PONDING AND/OR RUNOFF SHALL BE WATERTIGHT AND INSTALLED WITH RAINGUARD® INFLOW PAN OR APPROVED EQUIVALENT.
6. INSTALLATION OF FRAME & COVERS WITHIN CURB & GUTTER, VALLEY GUTTERS, OR SWALES ARE NOT ACCEPTABLE.




PRIVATE SEWER COVER

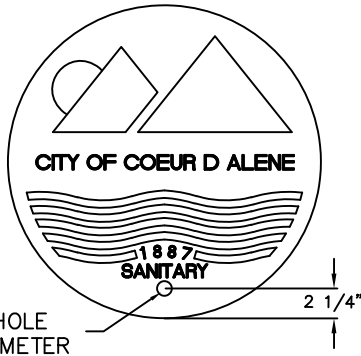


PUBLIC SEWER COVER

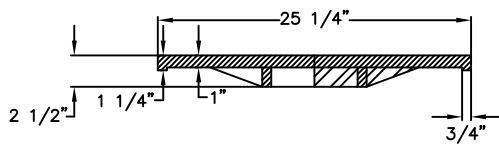


COVER SECTION VIEW

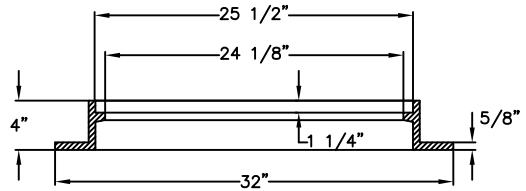

FRAME SECTION VIEW

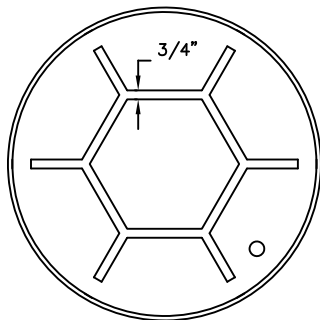

BOTTOM OF COVER

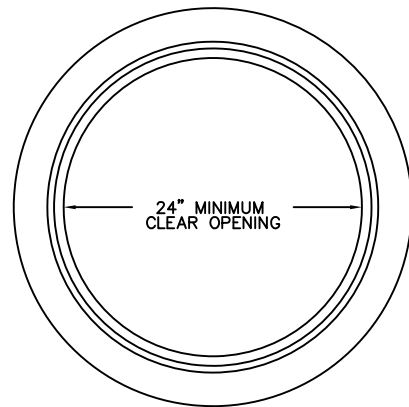

FRAME

REVISION	APPROVED	DATE	CITY OF COEUR d'ALENE STANDARD DRAWING	APPROVED BY:
				<h2>MANHOLE FRAME AND COVER</h2>
			DWG NO. SS-5	

6/18/18  
DATE: