



VAULT MANHOLE COVER

NOTES THIS DETAIL:


1. ALL LETTERING & ARTWORK SHALL BE FLUSH WITH FRAME RIM/LIP MOLDED INTO THE TOP OF THE COVER.
2. FRAME SHALL BE GRAY IRON CONFORMING TO A.S.T.M. A48-90, GRADE 30. COVER SHALL BE DUCTILE IRON CONFORMING TO A.S.T.M. A536-84, CLASS 80-50-06.
3. FIT TOLERANCES SHALL BE $< 1/8'' \pm$.
4. WELDED FRAME AND COVERS ARE NOT ACCEPTABLE.

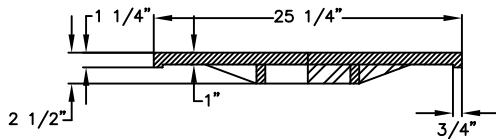


SECTION VIEW

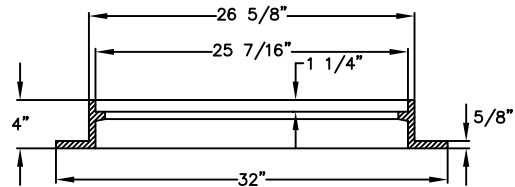

SECTION VIEW

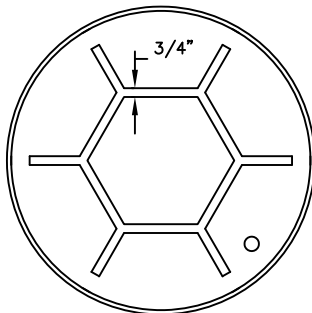

BOTTOM OF COVER

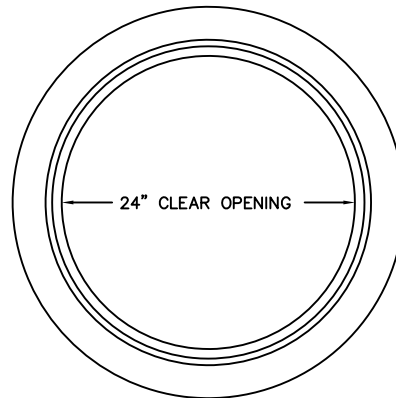

FRAME

| REVISION | APPROVED | DATE |
|----------|----------|------|
| | | |
| | | |
| | | |
| | | |

CITY OF COEUR d'ALENE STANDARD DRAWING

APPROVED BY:

**24" MANHOLE COVER
FOR METER VAULT**

Chris Bodley 6/18/18
CITY ENGINEER, PE 10804 DATE:

DWG NO. W-30