



SIDE VIEW

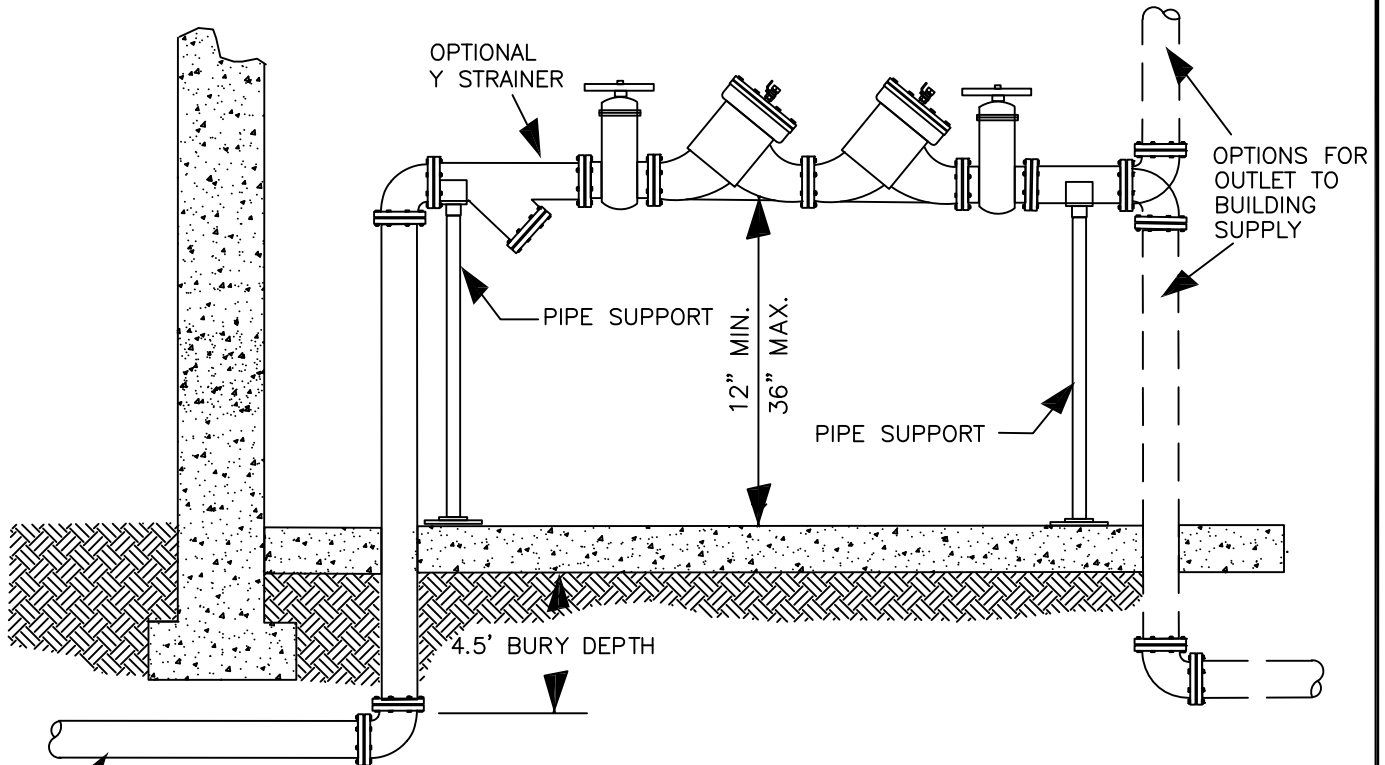

TOP VIEW

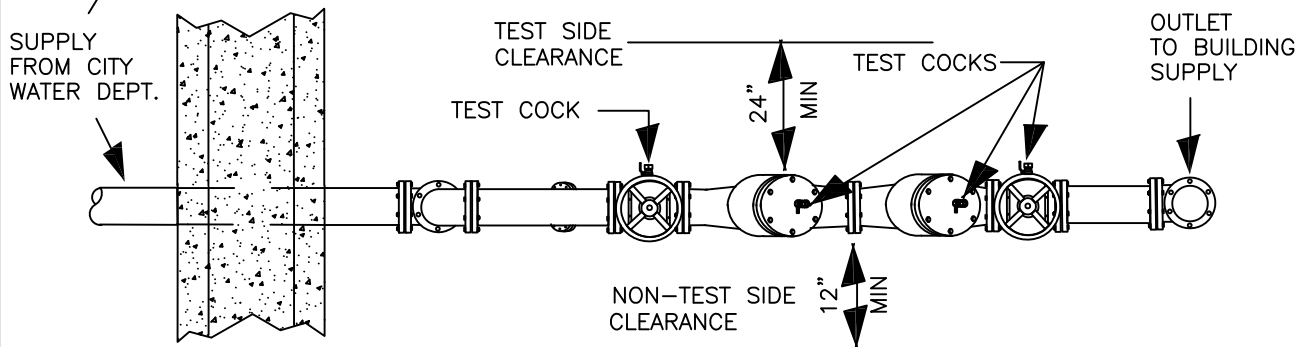

NOTES:

1. BACKFLOW ASSEMBLY MUST MEET U.S.C./IDAPA STANDARDS AND SPECIFICATIONS.
2. ASSEMBLIES MUST BE INSTALLED IN THEIR APPROVED ORIENTATION ONLY.
3. ADEQUATE CLEARANCE MUST BE PROVIDED FOR TESTING AND MAINTENANCE OF ASSEMBLY, MINIMUM 12\"/>



CITY OF COEUR D'ALENE STANDARD DRAWING

**APPROVED LARGE DC FOR
BUILDING ISOLATION**

APPROVED BY:

Chris Busby
CITY ENGINEER, PE 10604

3/23/26
DATE:

DWG NO.

W-46