




Notes:

1. All abandonments must be coordinated with Water Department staff a minimum of 48 hours in advance, unless otherwise directed.
2. Approved Romac or equivalent repair band of appropriate size shall be used.
3. Repair band shall extend a minimum of four inches (4") on either side of the tap (for 0.75–2" taps) or as recommended by the manufacturer.
4. Taps three inches (3") and larger shall require a section of water main to be removed and a new piece spliced in its place. This will be determined by the Water Department field staff and approved by the Water Department Director.
5. Work may involve existing tapping saddles or direct taps.
6. No backfilling shall occur until the abandonment has been inspected and approved by Water Department personnel.

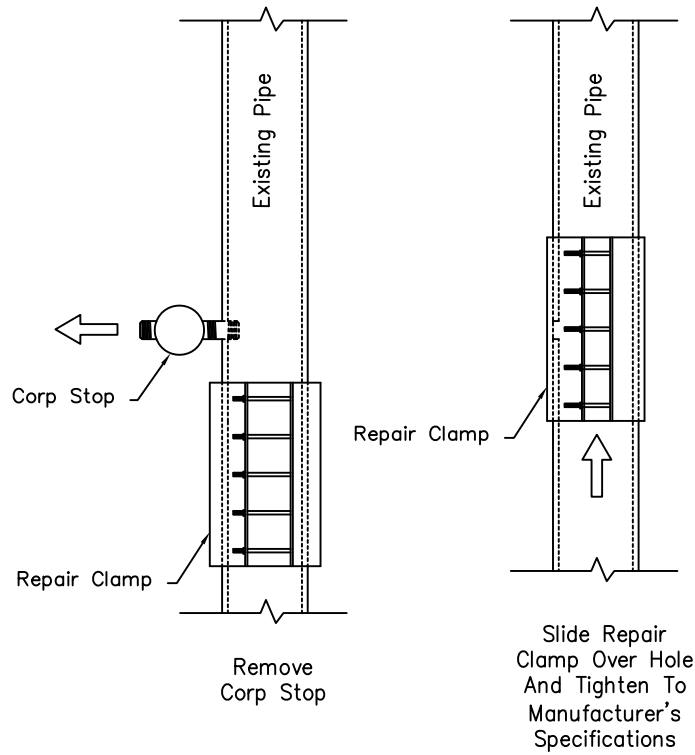

CITY OF COEUR D'ALENE STANDARD DRAWING

***CORP STOP/VALVE
ABANDONMENT***

APPROVED BY:

Chris Bosley
CITY ENGINEER, PE 10804

5/1/26
DATE:

DWG NO.

W-39