




Not to Scale

NOTES:

1. - - - - Expansion joints at curb returns, adjacent to structures, at 25' intervals, and between new and existing sidewalk.
2. ——— 3/4" grooves with 1/2" radius edges at 5' intervals.
3. Concrete shall be Portland Concrete Cement with a minimum 28 day compressive strength of 4000 PSI.
4. Non-contiguous sidewalk shall be used where feasible to provide a buffer from the roadway and space for snow storage, drainage swales, and utilities.
5. Public sidewalk must be within City right-of-way or dedicated easement.
6. Concrete surface must be finished with a light broom finish.
7. See Standard Drawing C-14 for Pedestrian Ramp design details.
8. Sidewalk must meet ADA requirements along entire property frontage.

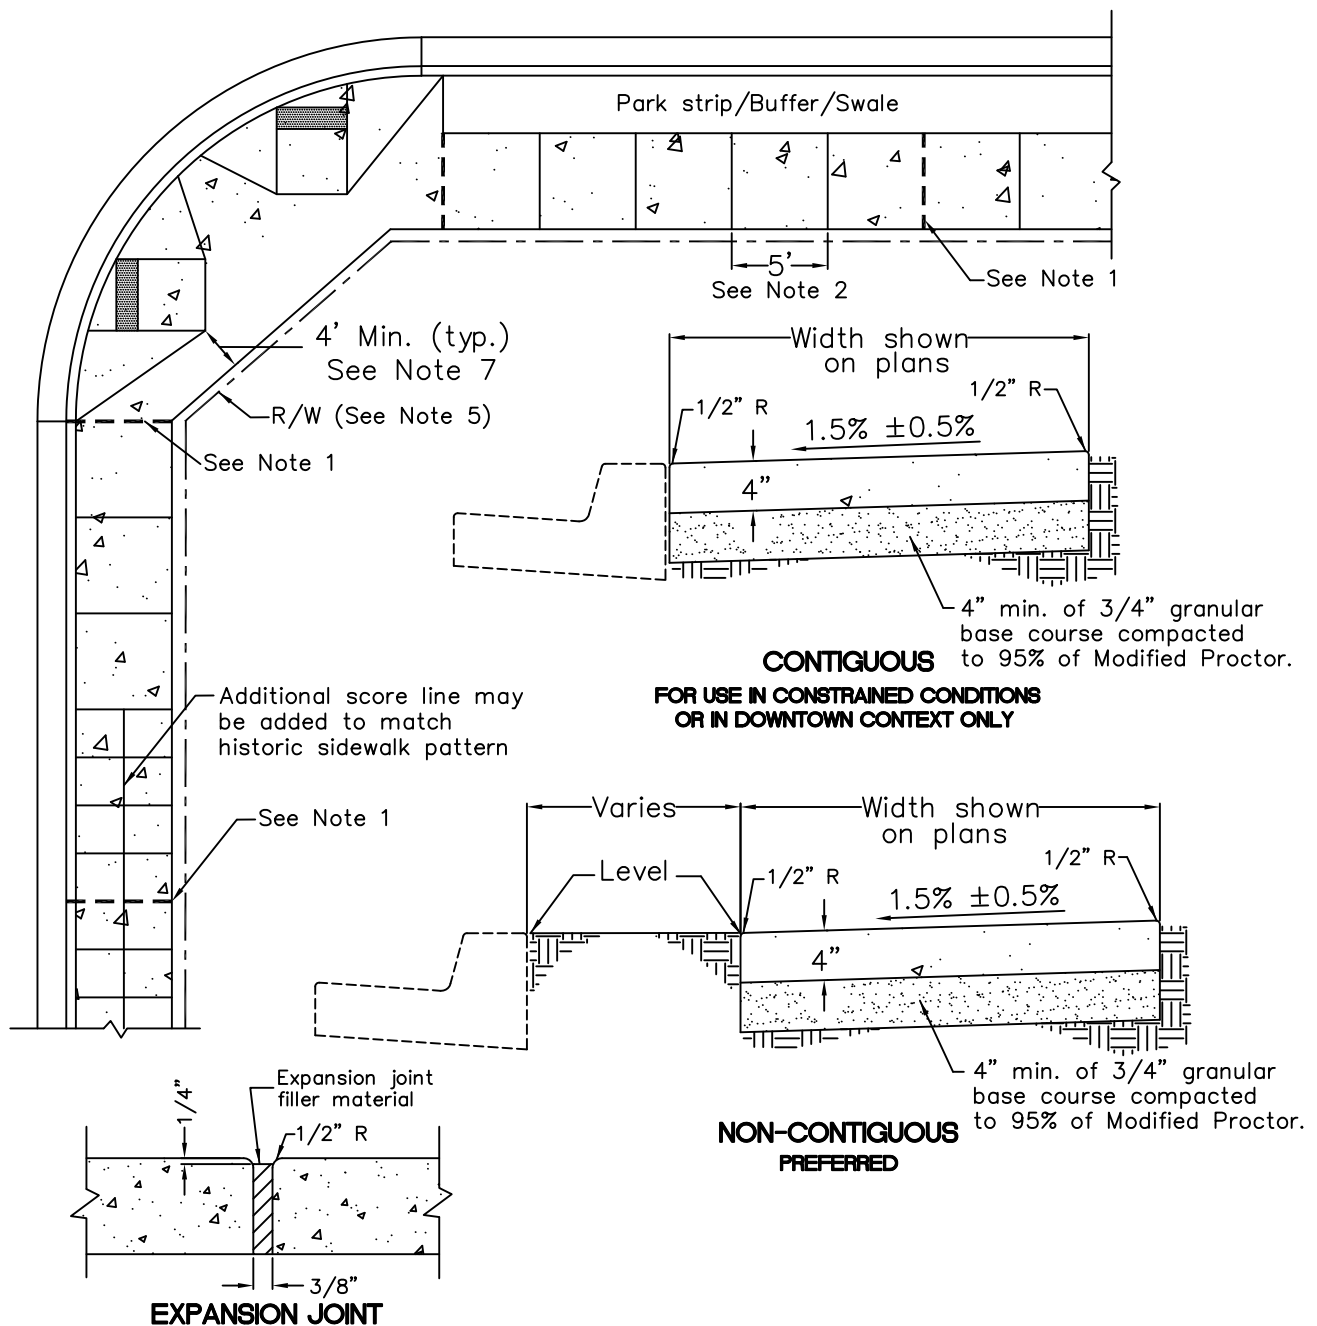

CITY OF COEUR D'ALENE STANDARD DRAWING

***SIDEWALK JOINTS
AND SECTIONS***

APPROVED BY:

Chris Bosley
CITY ENGINEER, PE 10804

7/24/26
DATE:

DWG NO.

C-5