SIDE VIEW

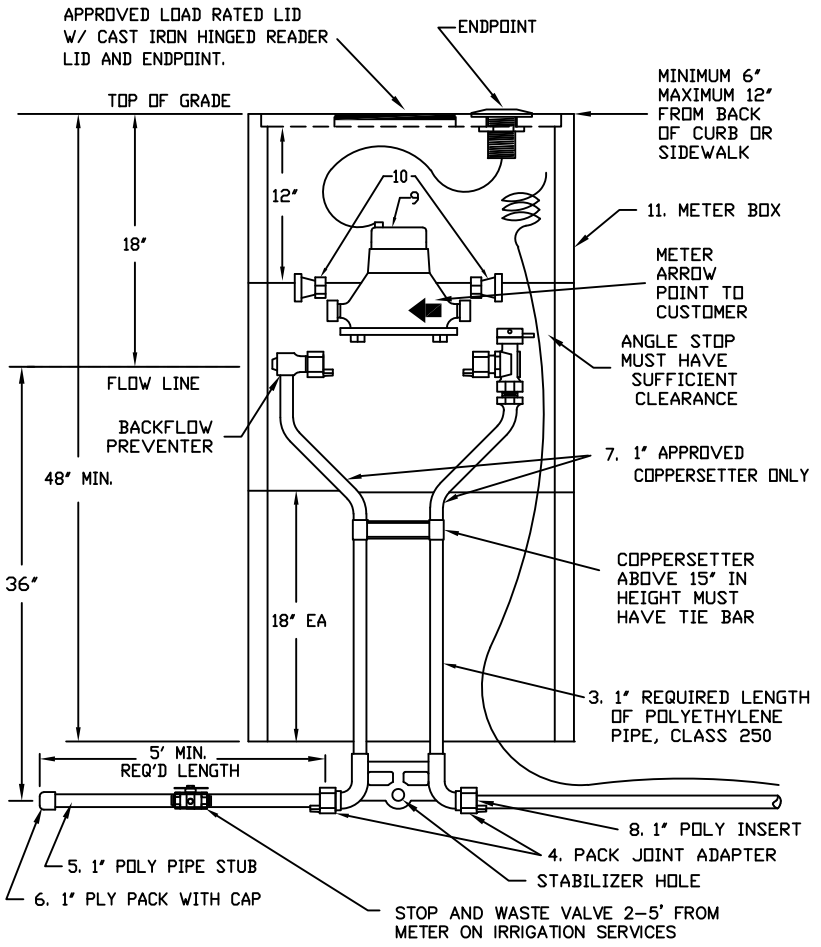

APPROVED TAPPING METHOD AND PARTS

APPROVED TAPPING METHOD

TOP VIEW

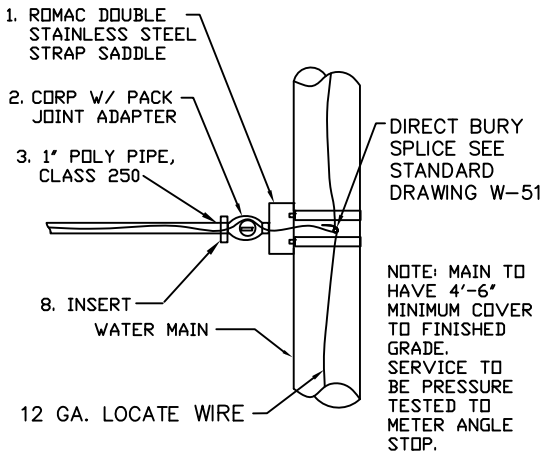

SIDE VIEW

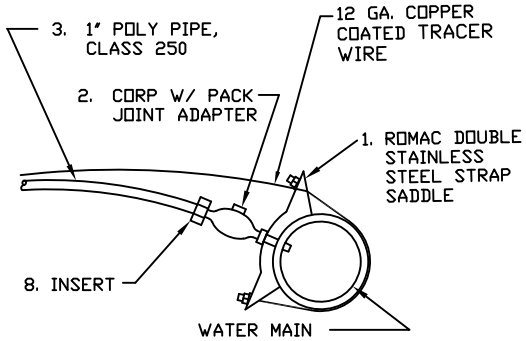

ITEM NO.	NO. REQ'D.	DESCRIPTION
1	1	1" ROMAC DOUBLE STRAP SERVICE SADDLE
2	1	IPS x 1" POLY PACK JOINT BRONZE CORPORATION STOP
3	1	1" x REQ. LENGTH – USE PIPE SIZE, 250 PSI POLYETHLENE SERVICE LINE
4	2	1" IPS x 1" POLY BRASS PACK JOINT ADAPTER
5	1	1" x MIN 5' LONG – POLY PIPE STUB DISCHARGE SIDE
6	1	1" MALE POLY PACK WITH CAP
7	1	1" APPROVED NSF 61 COMPLIANT COPPERSETTER, ALL COMPONENTS
8	3	1" POLY INSERTS WHERE NEEDED
9	1	3/4" OR 1" BADGER CELLULAR READ METER (METER LAY LENGTH=7 1/2")
10	2	A24 ADAPTERS
11	3	ARMORCAST 13X24 RPM OR DFW 1324WBC BOX W/ RADIO READ LID AND HINGED CAST IRON READER LID. BOX WILL CONSIST OF 18" BOTTOM AND MIDDLE SECTIONS, 12" TOP SECTION

NOTES:

1. ALL MATERIALS USED IN CONTACT WITH POTABLE WATER ARE TO BE NSF-61 COMPLIANT.
2. STABILIZER BAR MUST BE USED FOR SETTINGS HAVING POLY PIPE ON BOTH FRONT AND BACK SIDES.
3. NO PRIVATE CONNECTIONS OR FITTINGS ALLOWED INSIDE THE METER BOX.
4. POLY PIPE MAY BE USED WHEN CONNECTING TO AN EXISTING SERVICE WHEN A GALVANIZED CONNECTION CANNOT BE EASILY MADE.
5. SEE STANDARD DRAWING W-2 FOR METER LOCATION.



PLAN VIEW

City of Coeur d'Alene IDAHO

CITY OF COEUR D'ALENE STANDARD DRAWING

1" COPPERSETTER STANDARD PIT SETTINGS

APPROVED BY:

Chris Bosley

CITY ENGINEER, PE 10804

5/4/26

DATE:

DWG NO. W-1