



CITY OF COEUR D'ALENE STANDARD DRAWING

RPBA PREMISE ISOLATION ALTERNATE METHOD

APPROVED BY:

Chris Bushy
CITY ENGINEER, PE 10604


3/18/26
DATE:

DWG NO.


W-21

CITY STANDARD METER
SETTING, PER STANDARD
DRAWINGS W-1, W-14

CITY APPROVED RPBA PER
STANDARD DRAWING W-32

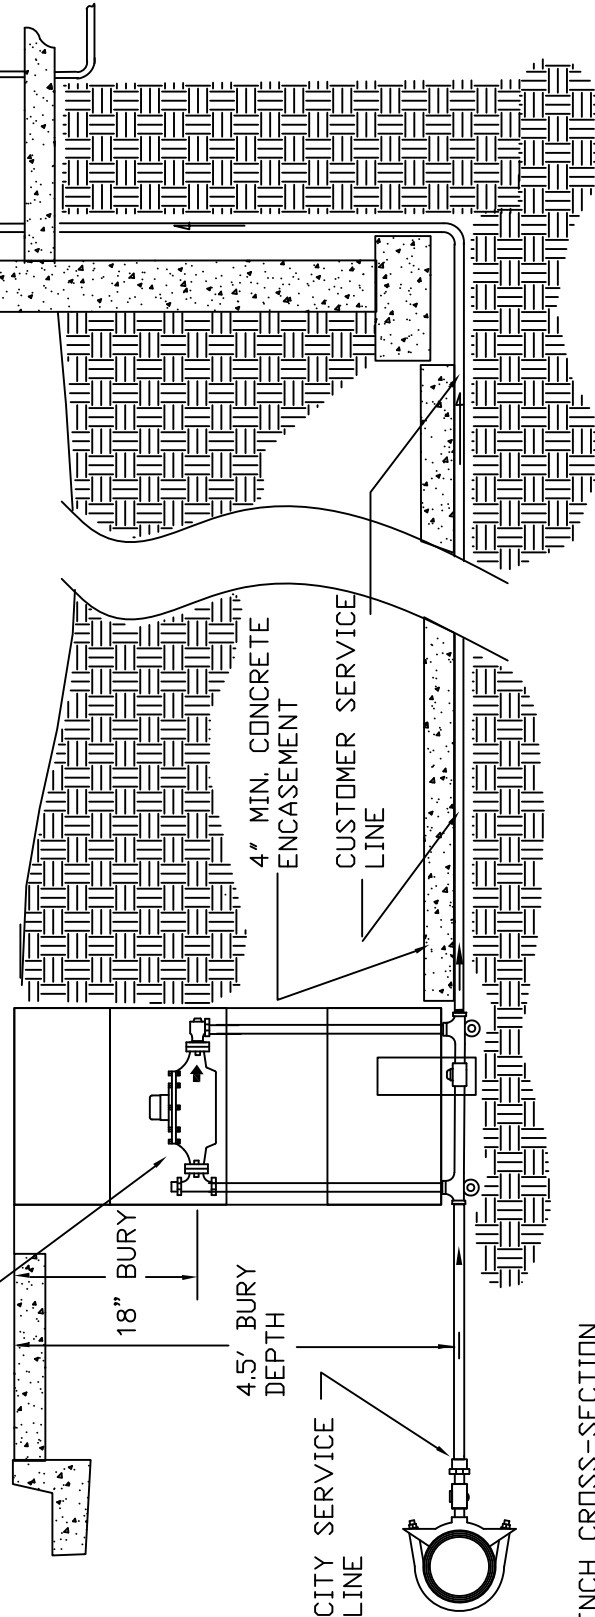

TRENCH CROSS-SECTION

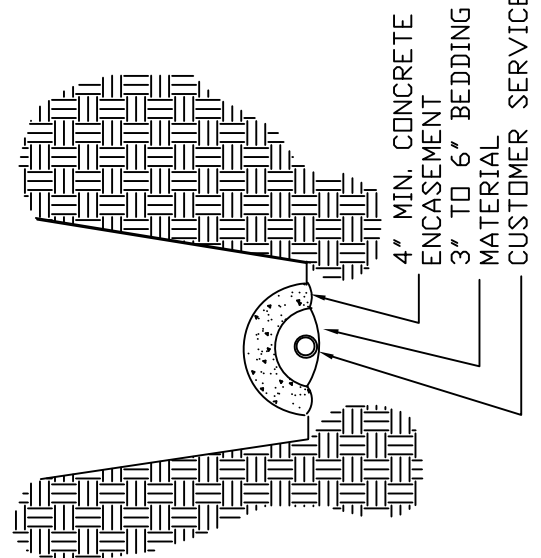

1. THE PROPERTY OWNER, AS A CONDITION OF ALLOWING THE RPBA TO BE INSTALLED INSIDE THE STRUCTURE, SHALL COVER THE CUSTOMER SERVICE LINE FROM THE BASE OF THE METER BOX TO THE BASE OF THE INLET RISER AT THE RPBA WITH A MINIMUM OF 4" OF CONCRETE OVER 3 TO 6" OF FINE BEDDING MATERIAL AS ILLUSTRATED.
2. THE PROPERTY OWNER SHALL SIGN A RECORDABLE EASEMENT PROHIBITING CONNECTIONS INTO THE SERVICE LINE BETWEEN THE METER AND THE RPBA. NO TEES ON THE INLET SIDE OF THE ASSEMBLY.
3. THIS METHOD SHALL BE UTILIZED WHERE AUXILIARY SOURCES OF WATER EXIST ON THE PROPERTY TO BE SERVED PER SPECIAL APPROVAL OF THE IDAHO DEPARTMENT OF ENVIRONMENTAL QUALITY.