




NOTE:

1. NO BLOW OFF PORTS ARE ALLOWED UPSTREAM OR DOWNSTREAM OF THE AVB. THE ASSEMBLY MUST BE REMOVED FROM THE SYSTEM PRIOR TO BLOWING OUT THE IRRIGATION SYSTEM.
2. NO MANUAL OR AUTOMATIC VALVES ALLOWED DOWNSTREAM OF AVB.
3. AVB CANNOT BE PRESSURIZED MORE THAN 12 HOURS IN A 24 HOUR PERIOD.

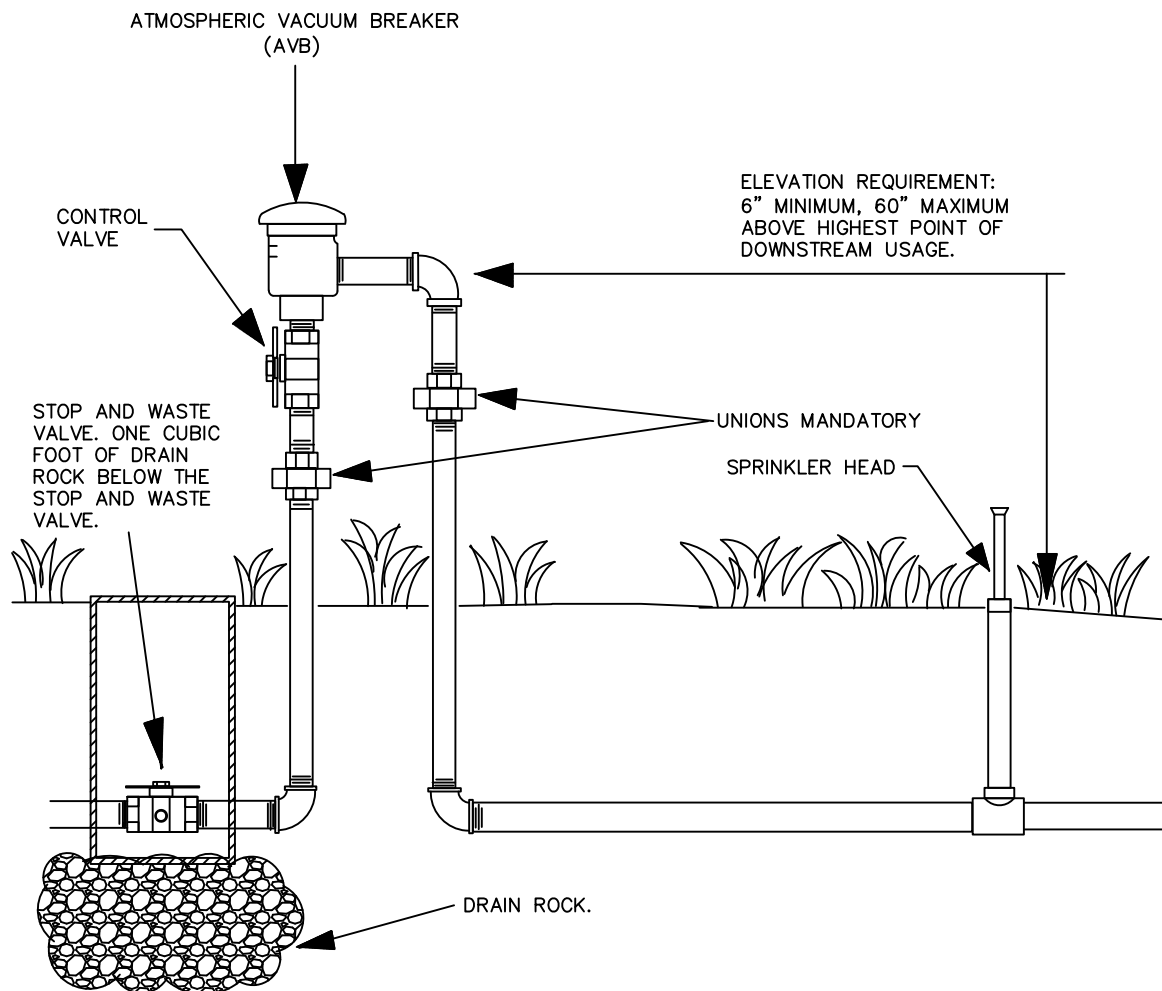

CITY OF COEUR D'ALENE STANDARD DRAWING

***APPROVED ATMOSPHERIC
VACUUM BREAKER INSTALL***

APPROVED BY:

Chris Busby 3/18/26
CITY ENGINEER, PE 10604 DATE:

DWG NO.

W-22