
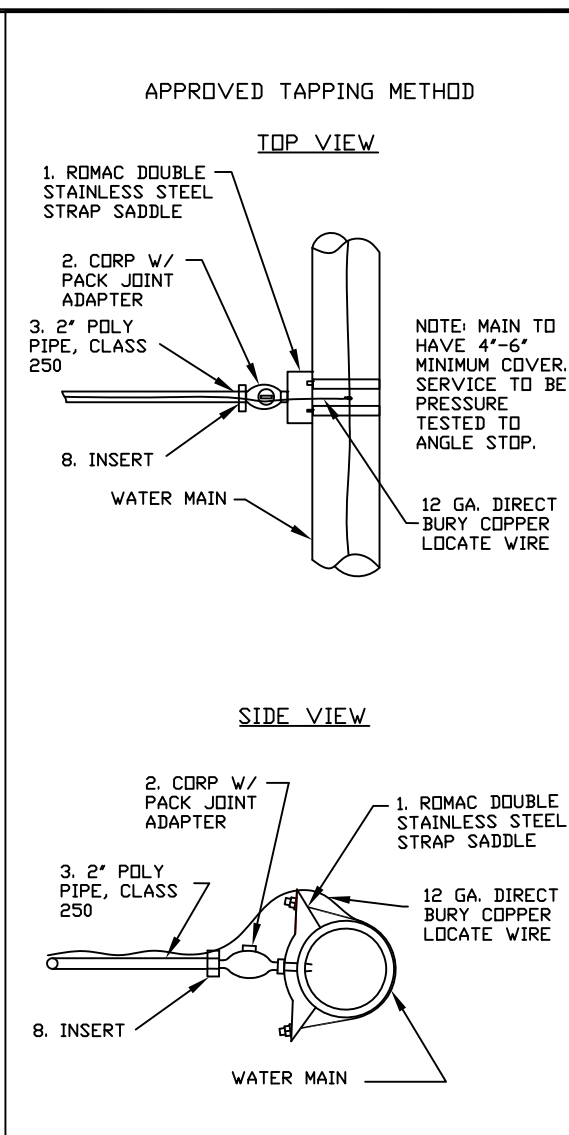


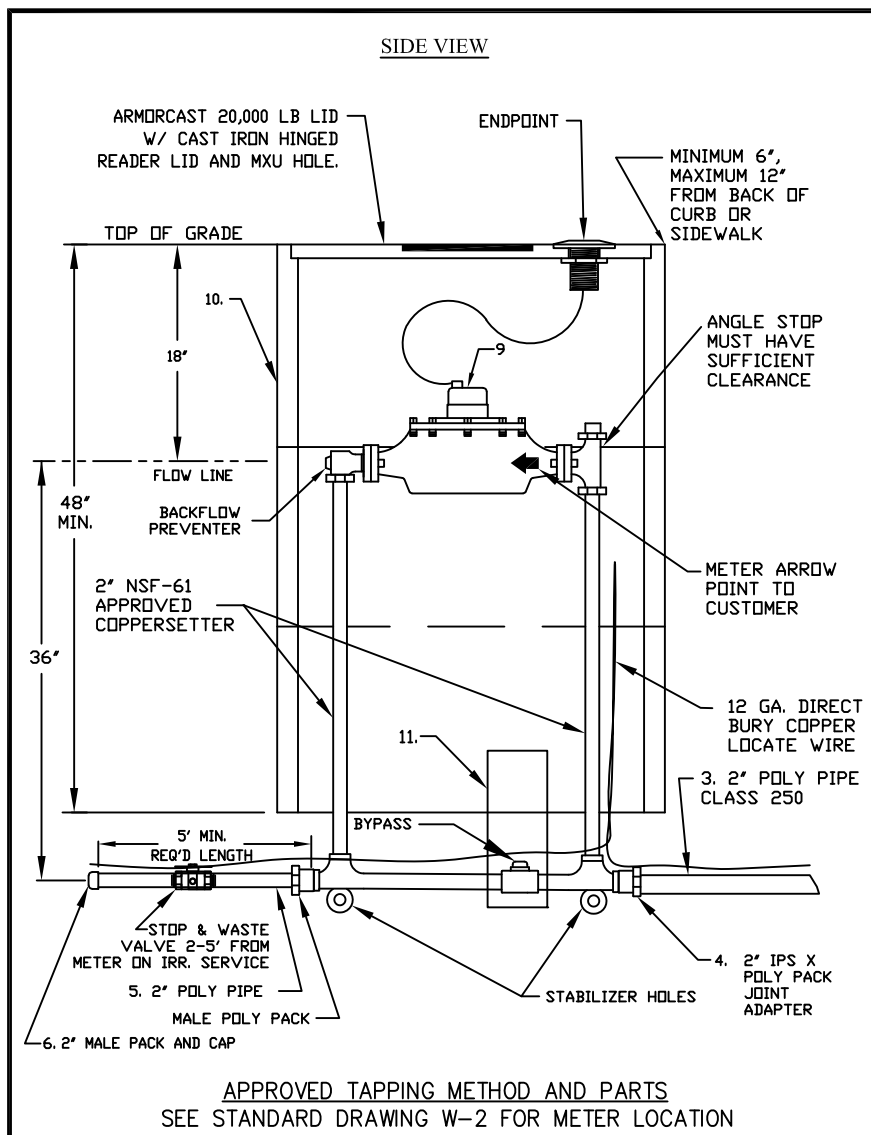


APPROVED TAPPING METHOD AND PARTS
SEE STANDARD DRAWING W-2 FOR METER LOCATION

ITEM NO.	NO. REQ'D.	DESCRIPTION
1	1	2" ROMAC DOUBLE STRAP SERVICE SADDLE
2	1	IPS x 2" POLY PACK JOINT BRONZE CORPORATION STOP.
3	1	2" x REQ. LENGTH - USE PIPE SIZE, 250 PSI POLYETHYLENE SERVICE LINE
4	1	2" IPS x 2" POLY BRASS PACK JOINT ADAPTER
5	1	2" x MIN 5' LONG - POLY AND MALE PACK JOINT <u>BACK SIDE OF BOX</u>
6	1	2" GALVANIZED CAP.
7	1	2" NSF-61 APPROVED COPPERSETTER, ALL COMPONENTS
8	2	2" POLY INSERTS WHERE NEEDED.
9	1	2" BADGER DISC TYPE CELLULAR READ METER (METER LENGTH=17")
10	4	ARMORCAST OR DFW 1324WBC METER BOX SECTIONS W/ CELLULAR READ LID - 17" X 30"
11	1	6" x 8" PVC SLEEVE SADDLE NOTCHED OVER BYPASS VALVE.

NOTES:

- ALL MATERIALS USED IN CONTACT WITH POTABLE WATER ARE TO BE NSF-61 COMPLIANT.
- STABILIZER BAR MUST BE USED FOR SETTINGS HAVING POLYPIPE ON BOTH FRONT AND BACK SIDES.
- NO PRIVATE CONNECTIONS OR FITTINGS ALLOWED INSIDE THE METER BOX.**
- POLY PIPE MAY BE USED WHEN CONNECTING TO AN EXISTING SERVICE IN THE EVENT THAT A GALVANIZED CONNECTION CANNOT BE EASILY MADE.
- OBSERVE MINIMUM UTILITY SEPARATION (WATER DEPARTMENT CONSTRUCTION STANDARDS - SUBSECTION 1.5.02)

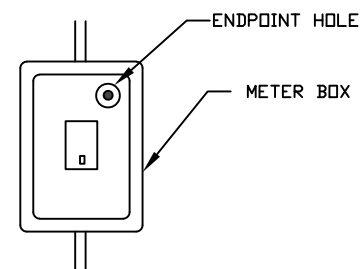

PLAN VIEW

METER BOX SHALL BE SQUARE
TO CURB OR SIDEWALK



CITY OF COEUR D'ALENE STANDARD DRAWING

2" COPPERSETTER STANDARD PIT SETTING

APPROVED BY:

Chris Bosley 5/4/26
CITY ENGINEER, PE 10804 DATE:

DWG NO.

W-14