


Section A-A

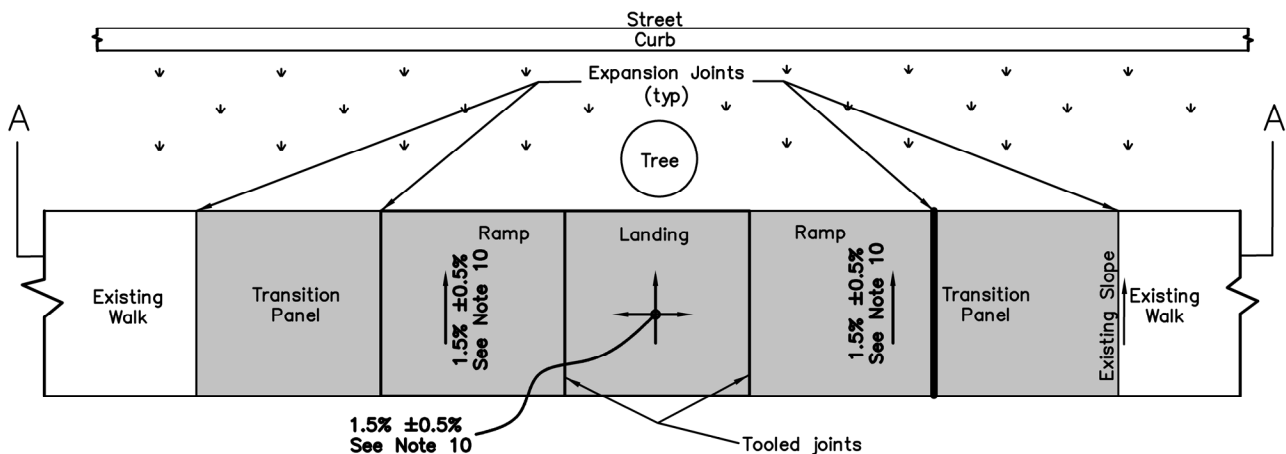

Plan View

Notes:

1. Allowable only with approval from the City's Urban Forester.
2. This plan does not apply for new sidewalk construction in undeveloped areas.
3. A 5-ft transition panel is required when cross slope of adjacent existing walk exceeds 2.0%
4. The maximum ramp running slope shall not require the ramp length (L) to exceed 15 ft to avoid chasing the slope indefinitely; increase the maximum running slope as directed by the Engineer. No additional construction tolerance is allowed.
5. Root areas shall be undisturbed as much as practical. Loose soil shall be lightly hand tamped. If root trimming is necessary contact the City Urban Forestry department.
6. Fill voids around roots to provide sidewalk support w/ layer of spoon excavatable Controlled Density Fill (CDF). A 1-inch minimum cover over the highest root is required.
7. See Std Dwg C-5 for general sidewalk requirements.
8. Place topsoil and hydroseed or sod to match existing conditions.
9. Raise, relocate, or replace existing sprinkler system as needed.
10. 1.0% minimum cross slope and 2.0% maximum cross slope. No additional construction tolerance is allowed.



CITY OF COEUR D'ALENE STANDARD DRAWING

**SIDEWALK REPAIR
RAMPING AT TREES**

APPROVED BY:

Chris Bosley
CITY ENGINEER, PE 10804

6/26/26
DATE:

DWG NO.

C-18