




NOTE:

1. THERE SHALL BE NO TEES ON THE INLET SIDE OF THE PVB.
2. NO BLOW OFF PORTS ARE ALLOWED UPSTREAM OR DOWNSTREAM OF THE PVB ASSEMBLY. THE ASSEMBLY MUST BE REMOVED FROM THE SYSTEM PRIOR TO BLOWING OUT THE IRRIGATION SYSTEM.
3. MANUAL OR AUTOMATIC VALVES ALLOWED DOWNSTREAM OF PVB.
4. MAY BE PRESSURIZED FOR MORE THAN 12 HOURS IN A 24 HOUR PERIOD.

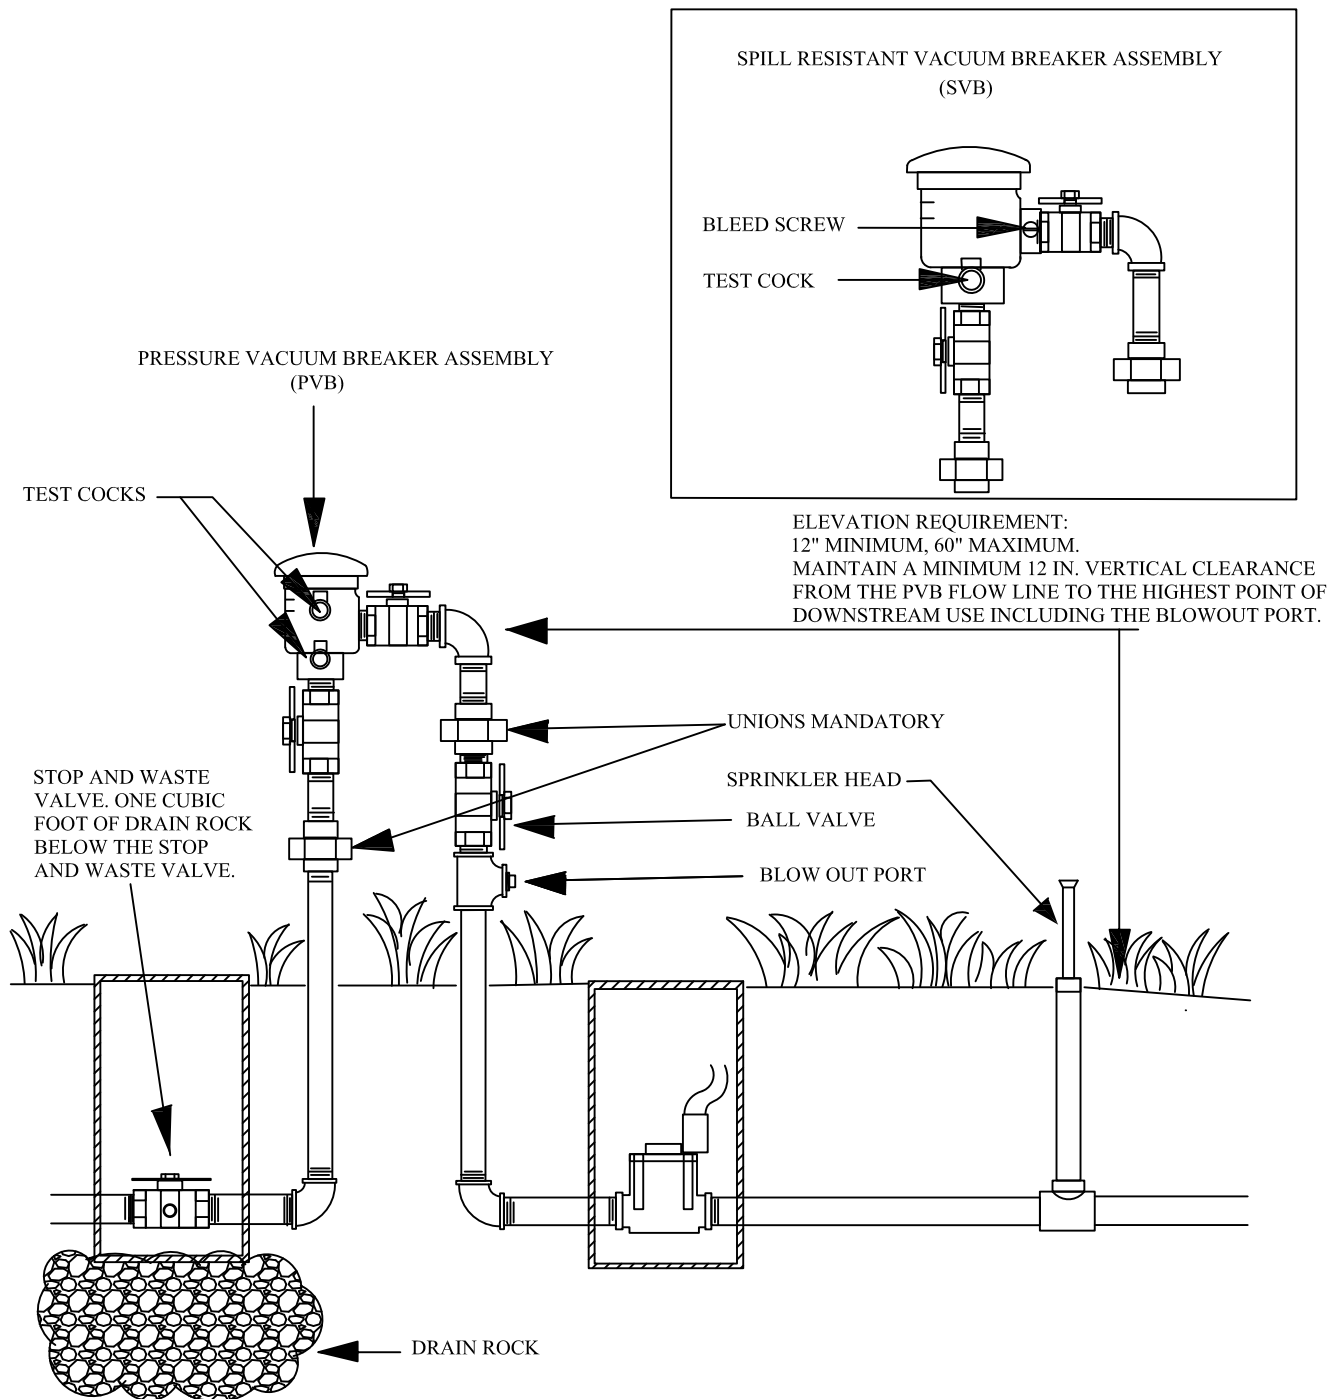

CITY OF COEUR D'ALENE STANDARD DRAWING

**APPROVED PRESSURE
VACUUM BREAKER ASSY.**

APPROVED BY:

Chris Boshy
CITY ENGINEER, PE 10604

3/18/26
DATE:

DWG NO.

W-23