




Not to Scale

GENERAL NOTES

1. Special backfill material for wells shall consist of washed gravel graded from 1" to 3" with a maximum of 5% passing the No. 200 screen, as measured by weight.
2. Space multiple drains 10' apart and 10' from driveways and curb inlet aprons.

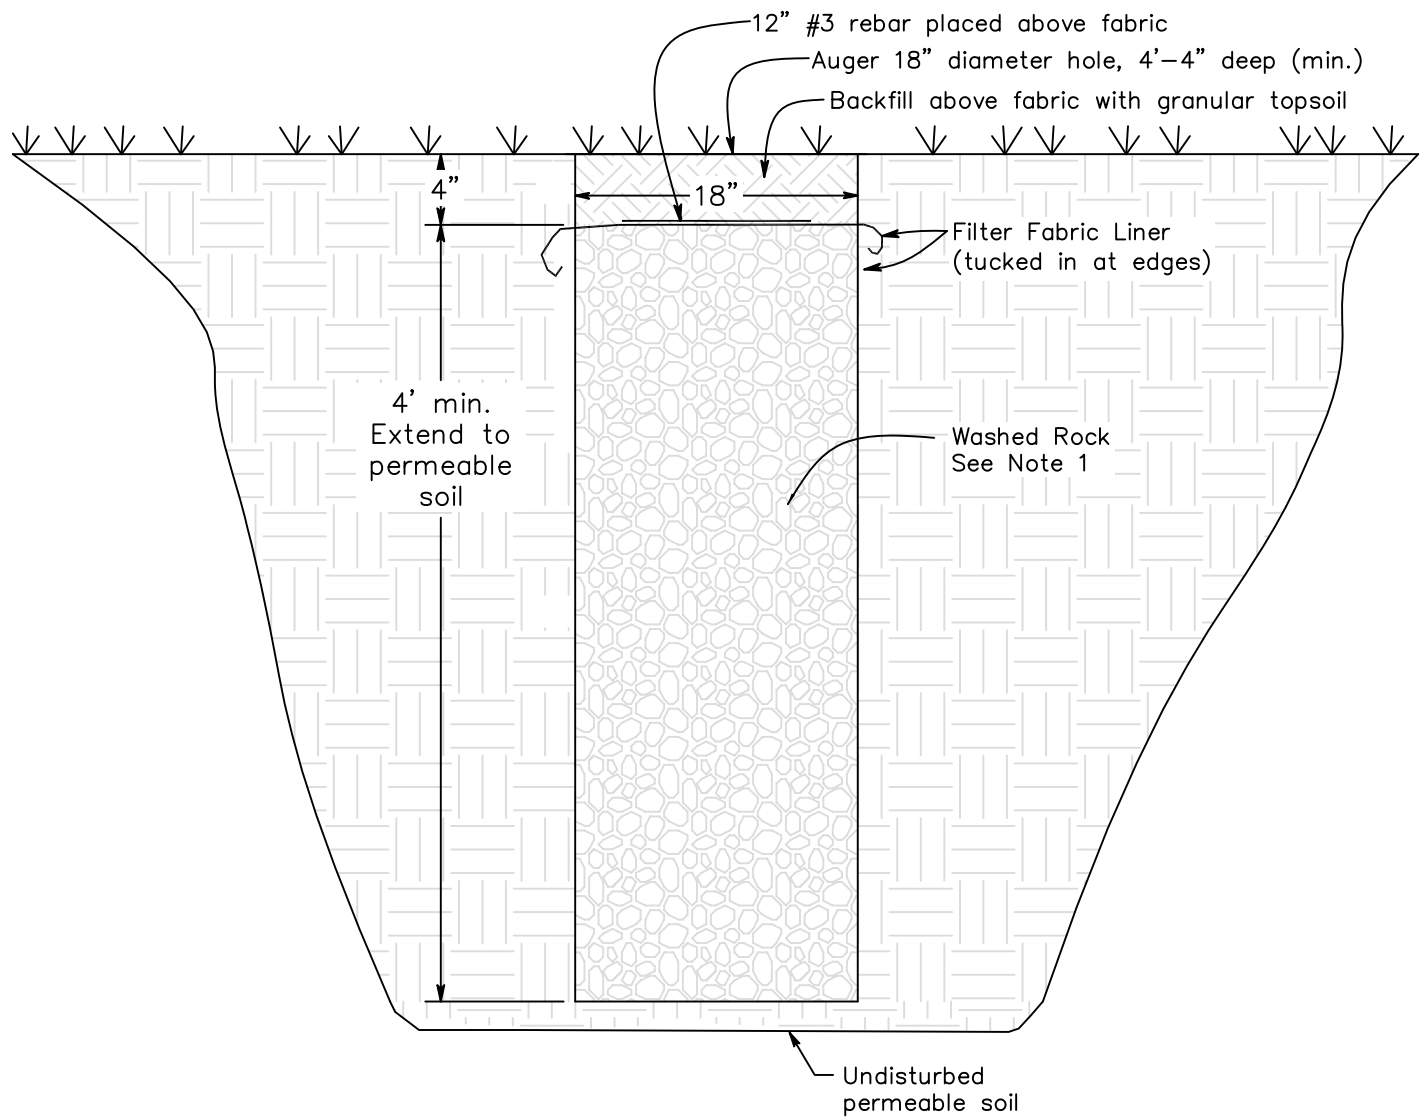

CITY OF COEUR D'ALENE STANDARD DRAWING

SWALE DRAIN

APPROVED BY:

Chris Bosley
CITY ENGINEER, PE 10804

7/14/16
DATE:

DWG NO.

SD-11